

## Datasheet FU.SEN.RSV.001 0-10V Heterodyne Contact Sensor IP65 S/N 569YYXXXX

### General description:

RSC are standalone ultrasound heterodyned voltage output sensors designed to be used with industrial standard measurement systems (such as PLC, DCS, and DAQ systems) and VIGILANT, powered by SDT.

The design is optimized for permanent installations in the most challenging environments. RSV contact sensors are suitable to ultrasound driven lubrication, mechanical monitoring, steam & valve systems, etc. Sensitive to friction, impact and turbulence, RSV deliver analog signals, adjustable in gain and in mode, that are image of the resonant ultrasonic band-pass.




### Features:


- Static (RMS value/DC coupling) or dynamic (heterodyned signal/AC coupling) output;
- On board amplification stages;
- Built-in analog filters;
- Hardware calibration;
- On board ambient T° measurement (through serial communication);
- Non-volatile memory (used to save configuration and recover sensor state/mode upon power outage);
- Unique ID;
- Digital I/O communication for simple use;
- Serial communication for advanced use.

### Top view pinout (IEC 60947-5-2 compliant):


- 1 = POWER SUPPLY (Brown)
- 2 = OUTPUT VOLTAGE (White)
- 3 = GROUND (Blue)
- 4 = COMMUNICATION LINE - should be left floating if not used – (Black)

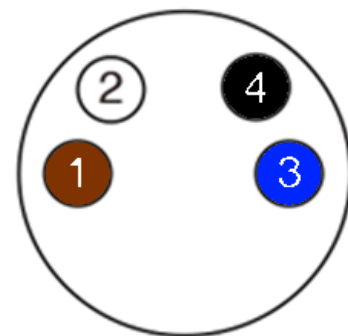

**Technical specifications:**

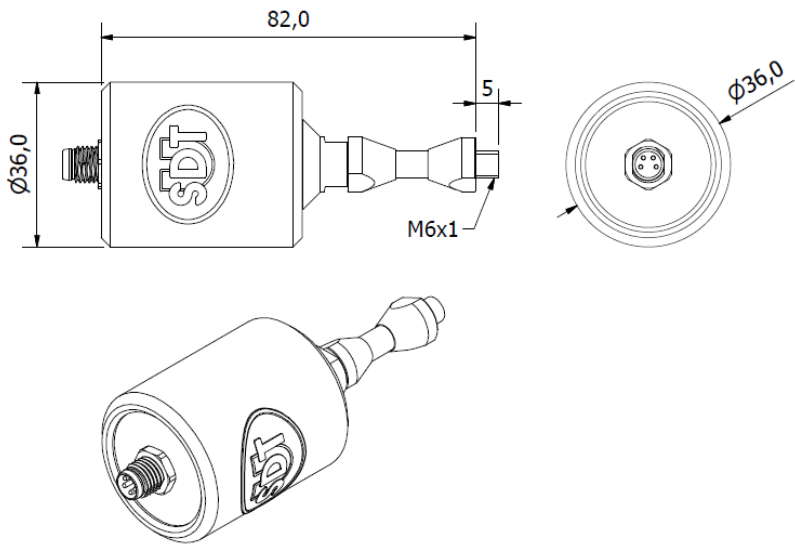
General specifications	
Dimensions [mm]	
Function	Resonant ultrasound contact sensor with heterodyned output
Type of transducer	Piezo electric ceramic
Materials	Housing: Stainless steel Connector plate: Aluminum Protection: Nitrile butadiene rubber
Weight	126 [Gram] / 4.44 [Oz]
IP rating	IP65
Tests/approvals EMC (Directive 2014/30/EU)	<ul style="list-style-type: none"> <li>• EN 61326-1:2013</li> <li>• EN 55011: 2016 + A1:2017</li> <li>• EN 61000-4-2:2009</li> <li>• EN 61000-4-3:2006 + A1:2008 + IS1:2009 + A2:2010</li> <li>• EN 61000-4-4:2013</li> <li>• EN 61000-4-6:2014</li> <li>• EN 61000-4-8:2010</li> </ul>
Installation	
Power supply	10 [V] to 30 [V]
Maximum consumption	1.2 [W]
Operating temperature	-20 [°C] to +70 [°C]/-4 [°F] to +158 [°F] (see SDT heat sink in section accessories for warmer environments)
Pinout voltage	GROUND to VDD
Recommended maximum cable length	30 [m] / 100 [feet]

Recommended tightening torque	2 [N.m] / 17.7 [lbf.in]
<b>Sensor signal (Typical)</b>	
Resonant frequency	37 [kHz] +/- 1 [kHz]
Gain range	0 [dB] to 60 [dB]
Gain step	12 [dB]
Connector	M8 - 4 pin - Male
<b>Heterodyned signal (Typical)</b>	
Heterodyne frequency	38.5 [kHz] +/- 1 [kHz]
Bandwidth	[0.25 – 4] [kHz], image of the ultrasonic signal
RMS Time Period	1 [s] (static mode only)
Absolute maximum voltage range	0.5 [V] to 10 [V] *Adjust the Gain if the voltage output is not within [1-5 V]
Full measuring range	~32-106 [dBμV] (in static mode)
<b>Factory configuration</b>	
Signal mode	Dynamic (sampleable from 10 kHz, referring to your recording instrument/PLC/VIGILANT dynamic output)
Gain	60 dB
<b>Optional accessories offered by SDT</b>	
<b>Cables with Straight M8 Connector - PUR RAL7021 -25°C.+90°C IP65 - STRAIGHT SHIELDED</b>	
FU.RSC.CABL.01.015-1	SENSOR-/ACTOR CABLE M8 4PF <> FREE END 1.5m
FU.RSC.CABL.01.030-1	SENSOR-/ACTOR CABLE M8 4PF <> FREE END 3.0m
FU.RSC.CABL.01.050-1	SENSOR-/ACTOR CABLE M8 4PF <> FREE END 5.0m
FU.RSC.CABL.01.100-1	SENSOR-/ACTOR CABLE M8 4PF <> FREE END 10.0m
FU.RSC.CABL.01.200-1	SENSOR-/ACTOR CABLE M8 4PF <> FREE END 20.0m
FU.RSC.CABL.01.XXX-1	SENSOR-/ACTOR CABLE M8 4PF <> FREE END XX.Xm
<b>Cables with 90° M8 Connector - PUR RAL7021 -25°C.+90°C IP65 - SHIELDED</b>	
FU.RSC.CABL.02.015-1	SENSOR-/ACTOR CABLE M8 4PF 90° <> FREE END 1.5m
FU.RSC.CABL.02.030-1	SENSOR-/ACTOR CABLE M8 4PF 90° <> FREE END 3.0m
FU.RSC.CABL.02.050-1	SENSOR-/ACTOR CABLE M8 4PF 90° <> FREE END 5.0m
FU.RSC.CABL.02.100-1	SENSOR-/ACTOR CABLE M8 4PF 90° <> FREE END 10.0m


FU.RSC.CABL.02.200-1	SENSOR-/ACTOR CABLE M8 4PF 90° <> FREE END 20.0m
FU.RSC.CABL.02.XXX-1	SENSOR-/ACTOR CABLE M8 4PF 90° <> FREE END XX.Xm
<b>Connector to complete assembly</b>	
SICOCA-M8-4MSS-01	CABLE CONNECTOR M8 4PM SHIELDED STRAIGHT A-KEY w/SCREW TERMINAL
SICOCA-M8-4FSS-01	CABLE CONNECTOR M8 4PF SHIELDED STRAIGHT A-KEY w/SCREW TERMINAL
<b>Cables with straight M8 connector 4PM &lt;&gt; M8 4PF - PUR BLACK -25°C.+80°C IP65 - STRAIGHT SHIELDED</b>	
FU.RSC.CABL.05.015-1	SENSOR-/ACTOR CABLE M8 4PM <> M8 4PF 1.5m
FU.RSC.CABL.05.030-1	SENSOR-/ACTOR CABLE M8 4PM <> M8 4PF 3.0m
FU.RSC.CABL.05.050-1	SENSOR-/ACTOR CABLE M8 4PM <> M8 4PF 5.0m
FU.RSC.CABL.05.100-1	SENSOR-/ACTOR CABLE M8 4PM <> M8 4PF 10m
FU.RSC.CABL.05.200-1	SENSOR-/ACTOR CABLE M8 4PM <> M8 4PF 20m
FU.RSC.CABL.05.XXX-1	SENSOR-/ACTOR CABLE M8 4PM <> M8 4PF XX.Xm
<b>Mounting accessories</b>	
FA.RSC.ACC.002-01	COMMONSense - HEAT SINK - AISI303 Ø30,0 (M6) x74,5mm
FU.SEACMAG-01	Flat Magnetic Foot
FU.SEACMAG-02	Curved Magnetic Foot
FU.SEACMP1	Mounting pad
FU.RSC.ACC.001	 Configuration Interface (see DC.RSC.DAT.015)

The foot is a part of the resonant structure, please do not disassemble it!

### Normalized heterodyned response curve (typical):

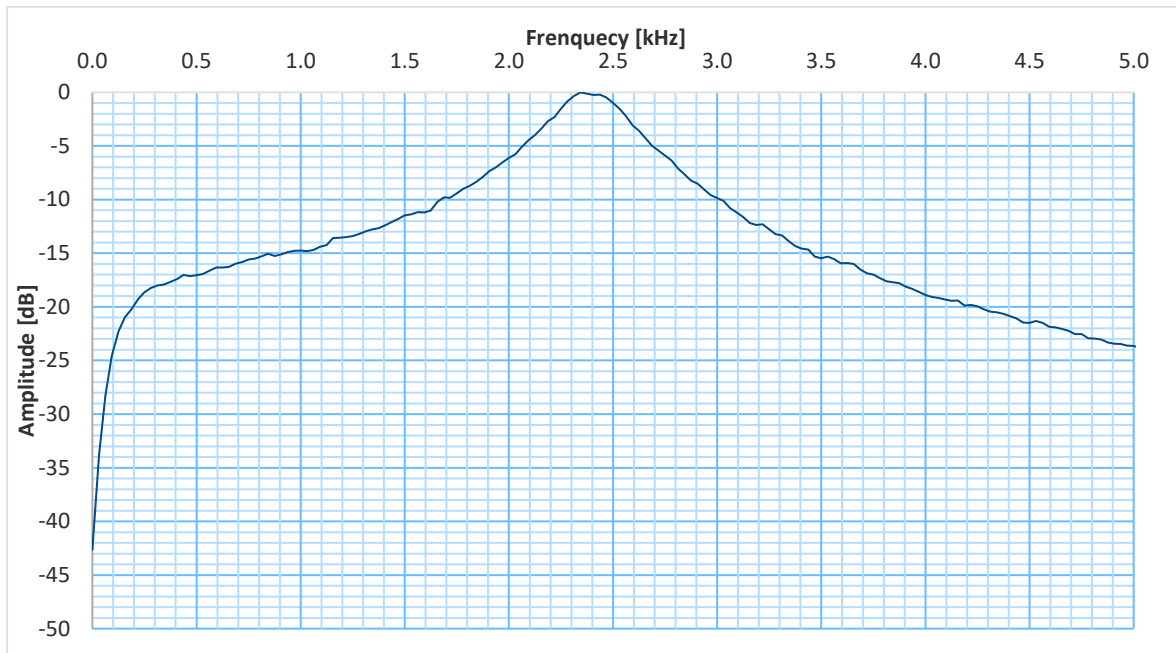

### Wiring configuration:

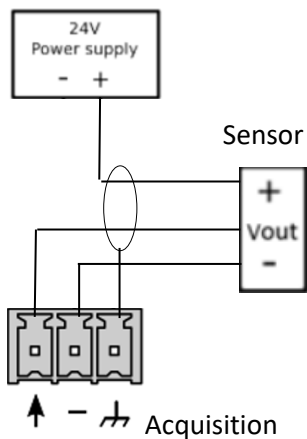

### Output equation in static mode:

- (1) Sensor signal  $[V_{RMS}] = \frac{\left(\frac{\text{Voltage } [V_{DC} \text{ in } V]}{25}\right)}{\text{linear Gain}}$
- (2) Sensor signal  $[dB\mu V_{RMS}] = 20 \times \text{Log} \left(\frac{\text{Voltage } [V_{DC} \text{ in } V]}{25}\right) - \text{Gain} [dB] + 120$
- (2') Sensor signal  $[dB\mu V_{RMS}] \sim 3.32 \times \text{Voltage } [V_{DC} \text{ in } V] + 91 - \text{Gain} [dB]$

In static mode, for convenience, SDT recommends expressing the sensor output in  $[dB\mu V_{RMS}]$  using (2) or (2') since the output refers to variation in RMS. Please refer to the approximation of the logarithmic scale given in (2'), in case you cannot enter the logarithmic relationship in your acquisition system. Approximating the logarithmic scale in the retain measurement range introduces a maximum related inaccuracy of +/- 2 dB.

Gain [dB]	Linear Gain	Sensitivity [V]/[V]	Offset/V <sub>bias</sub> [V]	Optimal range [dBμV <sub>RMS</sub> ]
0	1	25	0	[92-106]
12	4	100	0	[80-94]
24	16	400	0	[68-82]
36	63	1575	0	[56-70]
48	251	6275	0	[44-58]
60	1000	25000	0	[32-46]

Table 1: Sensitivities according to the gain

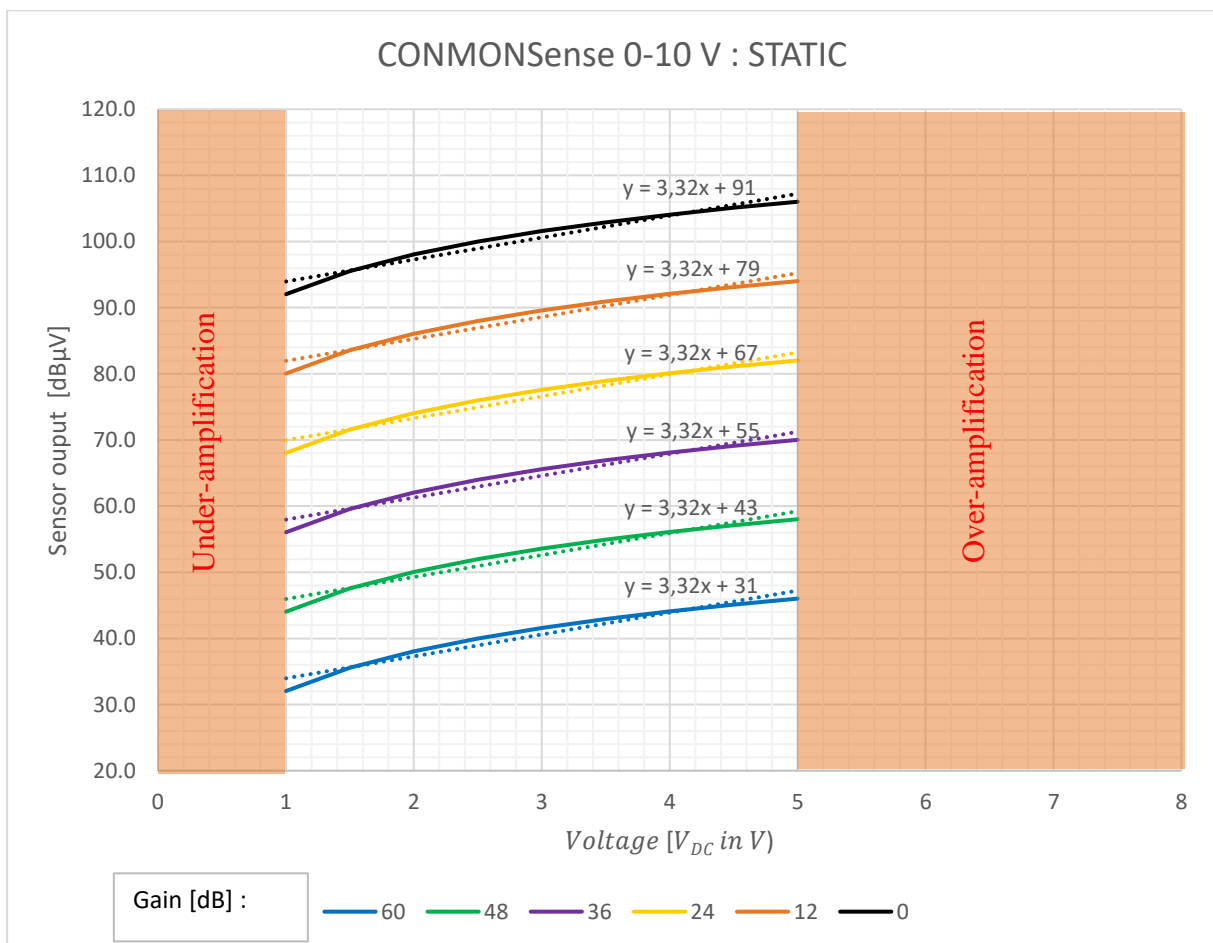


Figure 1: Sensor signal in dBμV vs Voltage, for each gain

Voltage [V <sub>DC in V</sub> ]	Gain [dB]					
	60	48	36	24	12	0
Sensor signal [dBμV]						
<1	Under-amplification					
1	32,0	44,0	56,0	68,0	80,0	92,0
1,5	35,6	47,6	59,6	71,6	83,6	95,6
2	38,1	50,1	62,1	74,1	86,1	98,1
2,5	40,0	52,0	64,0	76,0	88,0	100,0
3	41,6	53,6	65,6	77,6	89,6	101,6
3,5	42,9	54,9	66,9	78,9	90,9	102,9
4	44,1	56,1	68,1	80,1	92,1	104,1
4,5	45,1	57,1	69,1	81,1	93,1	105,1
5	46,0	58,0	70,0	82,0	94,0	106,0
> 5	Over-amplification					

Table 2: Voltage conversions in static mode




### Output equation in dynamic mode:

- (3) Sensor signal [V] = 
$$\frac{\left(\frac{\text{Voltage[in V]} - 3[V_{bias\text{in V}}]}{1.2}\right)}{\text{linear Gain}}$$




In dynamic mode, SDT recommends expressing the sensor output in Voltage.

Gain [dB]	Linear Gain	Sensitivity [V]/[V]	Offset/V <sub>bias</sub> [V]	Optimal range [mV]
0	1	1.2	3	[-1666 ; +1666]
12	4	4.8	3	[-418 ; +418]
24	16	19.2	3	[-105 ; +105]
36	63	75.6	3	[-26 ; +26]
48	251	301.2	3	[-6.6 ; +6.6]
60	1000	1200	3	[-1.7 ; +1.7]

Table 3 : Sensitivities according to the gain, in dynamic mode

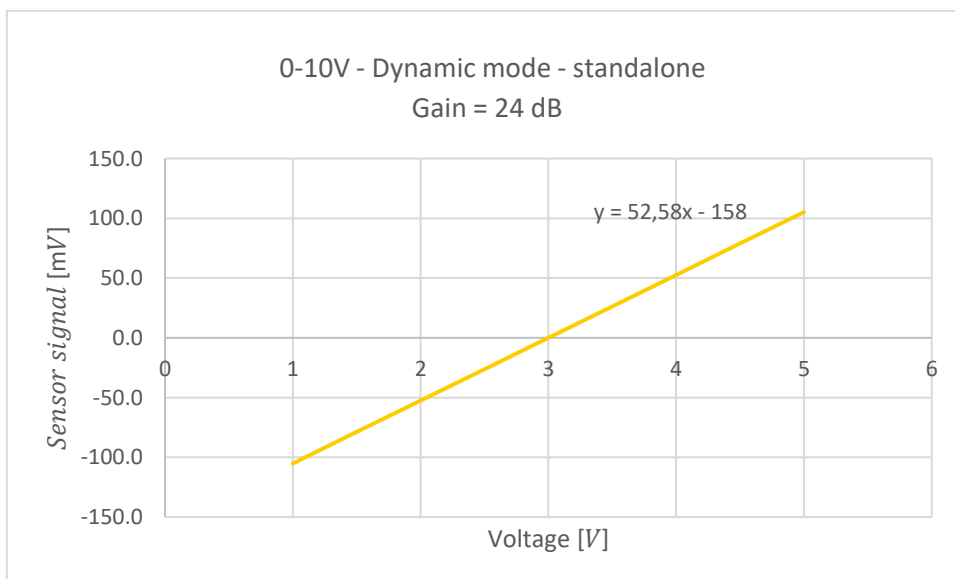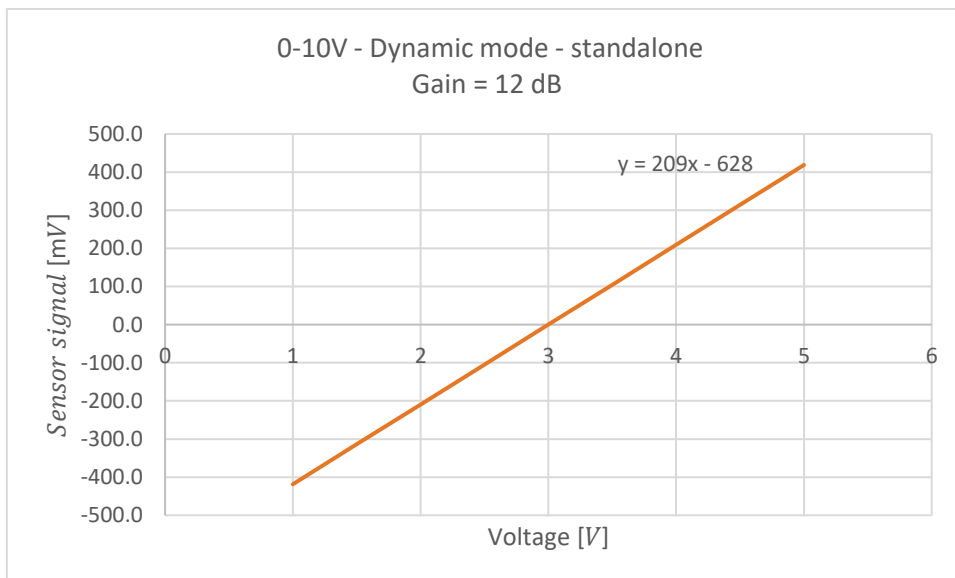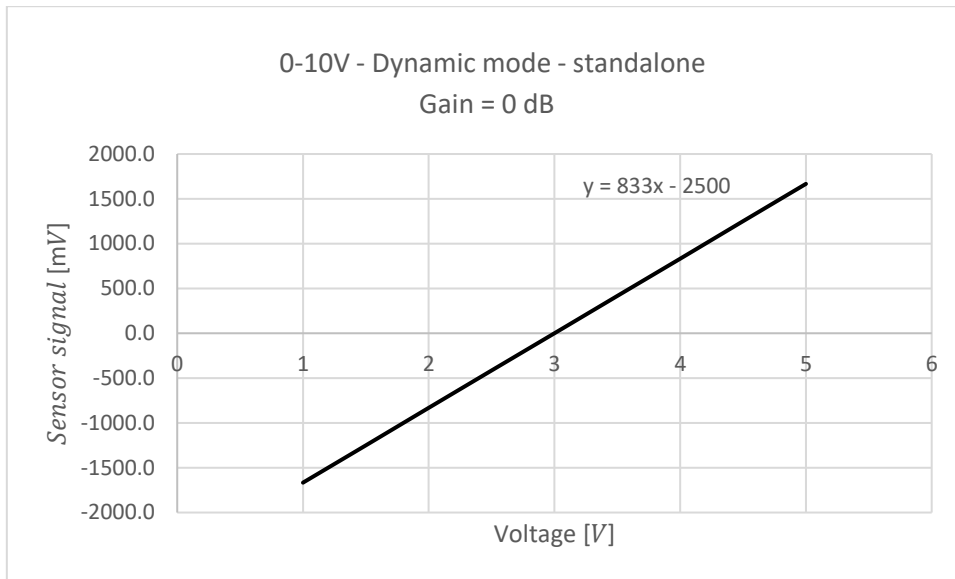



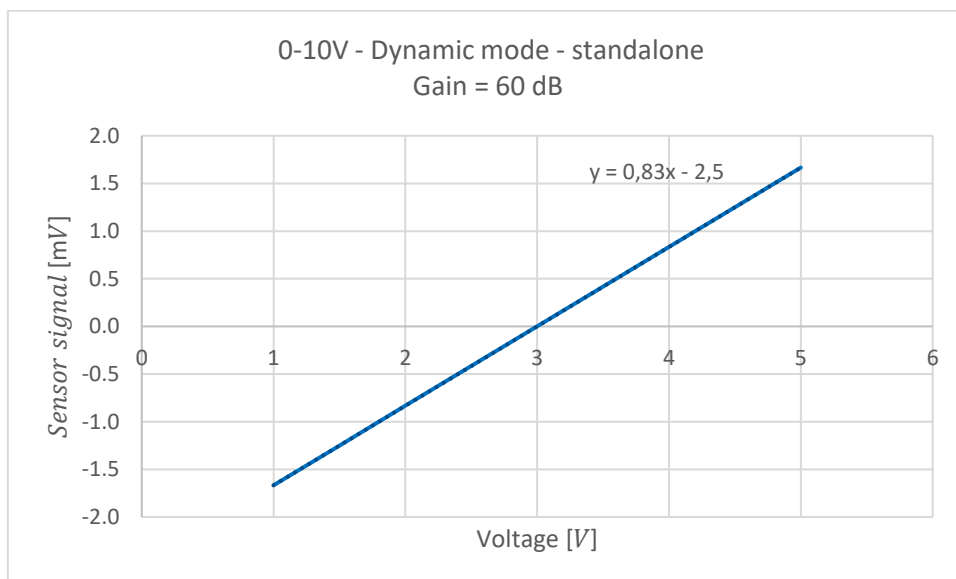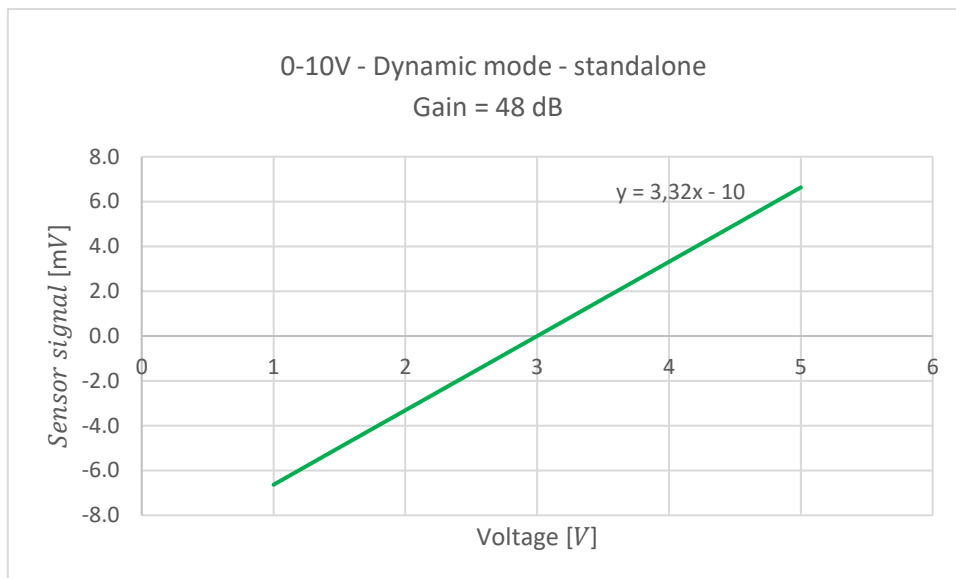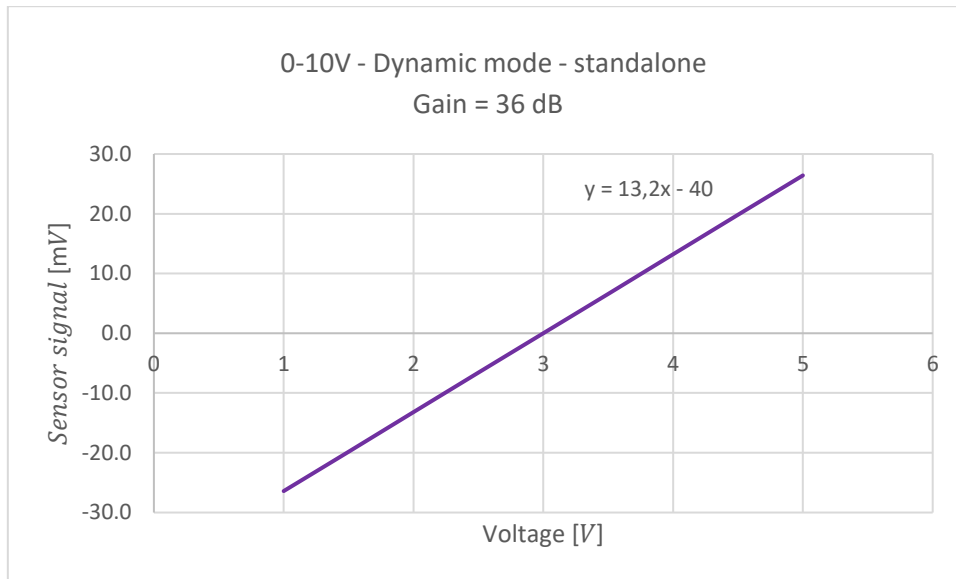

Voltage [V]	Gain [dB]					
	60	48	36	24	12	0
Sensor signal [mV]						
<1	Under-amplification					
1	-1,7	-6,6	-26,4	-105,2	-418	-1666
1,5	-1,3	-5,0	-19,8	-78,9	-314	-1250
2	-0,8	-3,3	-13,2	-52,6	-209	-833
2,5	-0,4	-1,7	-6,6	-26,3	-104	-416
$3/V_{bias}$	0,0	0,0	0,0	0,0	0,0	0,0
3,5	0,4	1,7	6,6	26,3	104	416
4	0,8	3,3	13,2	52,6	209	833
4,5	1,3	5,0	19,8	78,9	314	1250
5	1,7	6,6	26,4	105,2	418	1666
>5	Over-amplification					

Table 4: Voltage / voltage equivalence table, in dynamic mode


## Communication:

### Using the Configuration interface:

Gain and mode can be changed from a PC using the SDT accessory **FU.RSC.ACC.001**, in a simple way.

-**Download** then **install** the required SDT COMMONSENSE tool (compatible windows) at:

<https://sdtultrasound.com/support/software/>

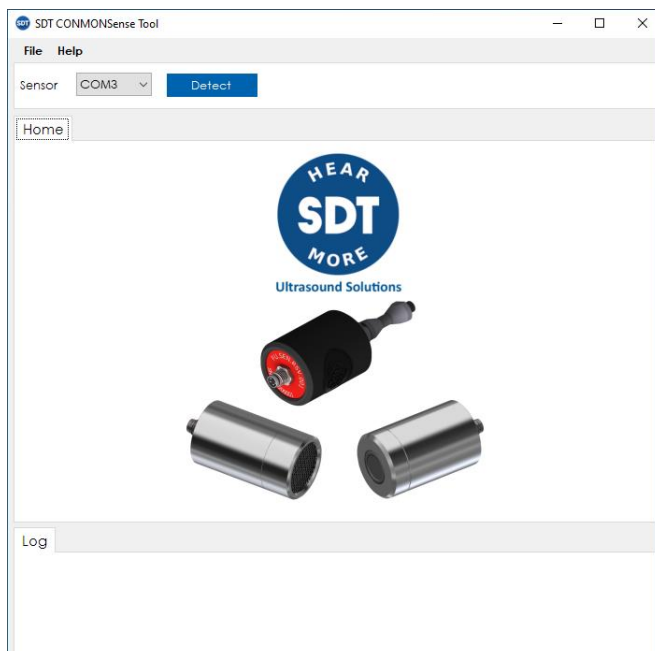

-**Connect** the sensor and the PC to the configuration interface using the provided cables.

-**Read** or **Write** the sensor settings

-**Apply** the settings in your acquisition system

## Digital output mode

Gain and mode can be selected by generating pulses on the communication line.

The default state of the line is +VDD (pulled up internally with a 10 [k $\Omega$ ] resistor) and a pulse consists in pulling the line down for at least 1 [ms] then releasing the line.


After the first pulse is initiated a 5 [s] internal timer is started. When the 5 [s] timeout occurs, the sensor counts how many pulses it received during this time-lapse:

- 1 pulse: increase the gain by 12 [dB] (has no effect if the gain is already at 60 [dB]);
- 2 pulses: decrease the gain by 12 [dB] (has no effect if the gain is already at 0 [dB]);
- 3 pulses: change the mode (switch between static and dynamic mode);
- 4 pulses: initialize the sensor in dynamic mode with a gain of 60 [dB] (factory reset);

After any modification, data are saved inside a non-volatile memory and are restored on sensor power on. Once installed, make sure that the sensor is always in a non-saturated configuration (Gain), compatible with your acquisition instrument (Mode). To rescale the signal output, please do not forget to add to set up the input channel of your acquisition instrument according to this datasheet.

### Example

- Change the output mode (generate 3 pulses under 5 [s]).

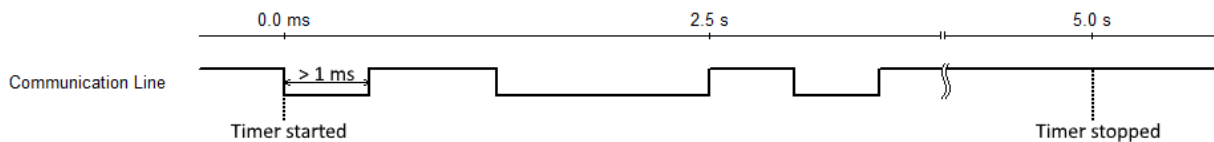

## Serial mode

The communication line can also be used for a serial communication allowing advanced features. The protocol used is UART 9600-8-E-1 (9600 bauds, 8 data bits, 1 even parity bit, 1 stop bit). The user can write data to the sensor and read them back:

- 1) The serial communication is initialized by the user by sending the header byte <AAh>.
- 2) The second byte is the device address or the generic address (<00h>). The sensor will only answer to its specific address or to the generic address.
- 3) The third byte is the memory address (see below) that the user wants to write or to read.
- 4) The fourth byte is the operation: <00h> for a write operation; <01h> for a read operation.
- 5)
  - a) During a write, the fifth byte is sent by the user with the data that needs to be written.
  - b) During a read, the fifth byte is sent by the user and contain the one-byte checksum.
- 6)
  - c) During a write, the sixth byte is sent by the user and contain the one-byte checksum.
  - d) During a read, the sixth byte is sent by the sensor containing the value of the memory address.

The one-byte checksum is the LSB (least signification byte) from the addition of all bytes sent.

After any modification, data are saved inside a non-volatile memory and are restored on sensor power on.

### Memory address

00	Sensor specific address (R/W)	range 0 to 255
01	Sensor gain (R/W)	range 0 to 60 with a step of 12

02	Sensor mode (R/W)	1 for static mode; 2 for dynamic mode
03	Temperature (R)	8bits integer temperature value
04	Temperature (R)	32bits float temperature value byte 1 (LSB)
05	Temperature (R)	32bits float temperature value byte 2
06	Temperature (R)	32bits float number temperature value byte 3
07	Temperature (R)	32bits float number temperature value byte 4 (MSB)
08	Firmware version (R)	32bits integer firmware version value byte 1 (LSB)
09	Firmware version (R)	32bits integer firmware version value byte 2
10	Firmware version (R)	32bits integer firmware version value byte 3
11	Firmware version (R)	32bits integer firmware version value byte 4 (MSB)

### Examples

- e) write a new specific device address, <11h> to the sensor:

*User: <AAh 00h 00h 00h 11h BBh>*

(Checksum is AAh + 11h = BBh)

- f) Read the sensor gain (assuming the gain is set at 48 [dB] and the device specific address is set to <11h>):

*User: <AAh 11h 01h 01h BDh>*

*Sensor: <30h>*

(Checksum is AAh + 11h + 01h + 01h = BDh)

11	CMA 28/02/2023	T° range + harmonization	RGO
10	CMA 08/02/2022	Configuration interface	RGO
09	CMA 26/11/2021	Conversion charts & tables + tests/approvals	RGO
08	CMA 20/04/2021	Max cable length	RGO
07	CMA 10/11/2020	New info in tables + factory reset+graph	RGO
06	CGI 29/10/2020	No commas but dots	RGO
05	RGO 28/10/2020	Modified output equation	CGI
04	RGO 21/10/2020	Added serial number	CGI
03	RGO 20/10/2020	RSV datasheets modified for Vigilant compatibility	CGI
02	RGO 20/10/2020	Modified Serial Communication	CGI
01	RGO 26/08/2020	Original version	CGI
<b>Revision</b>	<b>Writer</b>	<b>Nature of modification</b>	<b>Approved</b>

*The information herein is believed to be accurate to the best of our knowledge.*

*Due to continuous research and development, specifications are subject to change without prior notice.*